
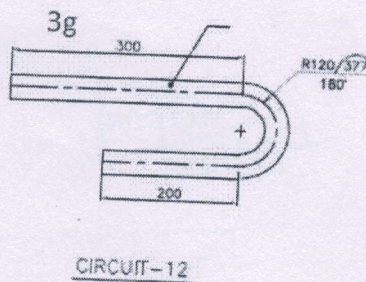
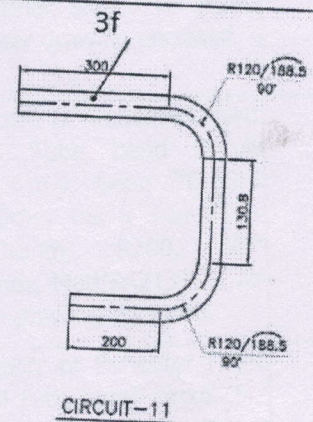
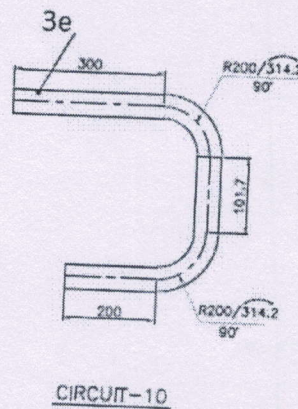
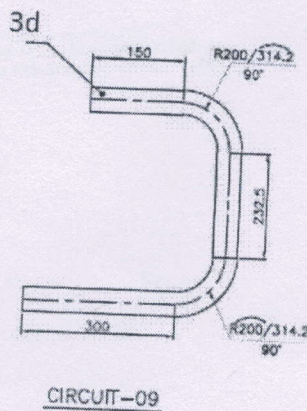
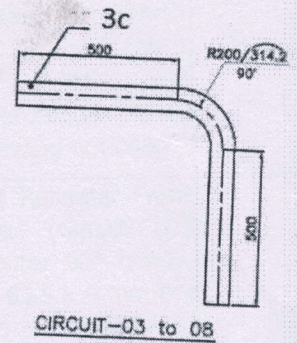
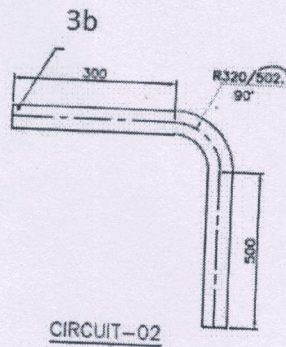


FRONT REHEATER

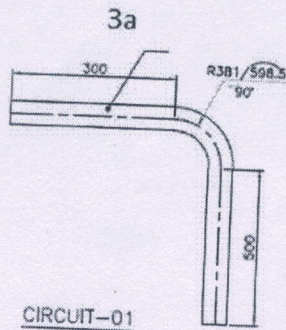

3g	TUBE OD 63.5 X 5 THK; LG = 877	SA 213 T91	
3f	TUBE OD 63.5 X 5 THK; LG = 1007.8	ATTESTED	1
3e	TUBE OD 63.5 X 5 THK; LG = 1230.1	SA 213 T91	1
3d	TUBE OD 63.5 X 5 THK; LG = 1310.9	ATTESTED	1
3c	TUBE OD 63.5 X 5 THK; LG = 1314.2	SA 213 T91	1
3b	TUBE OD 63.5 X 5 THK; LG = 1302.7	ATTESTED	1
3a	TUBE OD 76.1 X 5 THK; LG = 1398.5	SA 213 TP 347H	1
ITEM	DESCRIPTION	DRAWING No.	ATTESTED
No.			MATL. SPECN. UNIT WT.
			ATTESTED/CERTIFIED QTY.

BILL OF MATERIALS

COSTUMER			
NORTH CHENNAI THERMAL POWER STATION-II			
ATHIPATTUPUTHUNAGAR, CHENNAI-600 120			
TITLE			
RE HEATER FRONT COIL ASSY.BEND			
DRAWN	SCALE	CUSTOMER DRG No.	
CHECKED	N.T.S	--	
APPROVED	SHEET	DRAWING No.	
			#REVISION

AE/IRM-I

AE/IRM-I

EE/IRM